


INSTALLATION	ITEM NO.	QUIKSET NO.	CARSON
PARKWAY	BTE-5	104-4200	TE-46

NOTES

- 1. BURIED TRANSFORMER ENCLOSURE TO BE FURNISHED COMPLETE WITH BAFFLE CONE, GALVANIZED TAMPER VENT, GALVANIZED GRATING, AND GALVANIZED HARDWARE.
- 2. SEE UGS-735.1 FOR PLASTIC BURIED TRANSFORMER ENCLOSURE INSTALLATION REQUIREMENTS.
- 3. GRATE FOR SIDE WALK INSTALLATION SHALL HAVE FLATTENED EXPANDED METAL (1/2" NO. 13 GA) TOP COVERING WELDED IN PLACE PRIOR TO GALVANIZING.
- 4. ALL B.T.E.'S SHALL BE FURNISHED WITH STAINLESS STEEL, PENTA HEAD CAP SCREWS FOR COVER SECURING.

DRAWN:	UNDERGROUND STRUCTURES STANDARDS	
CHECKED:	BURIED TRANSFORMER ENCLOSURE	UGS-734.1
APPROVED:	PLASTIC	
DATE: 8/11/1998	(HDPE OR POLYSTYRENE)	PAGE 1 OF 2



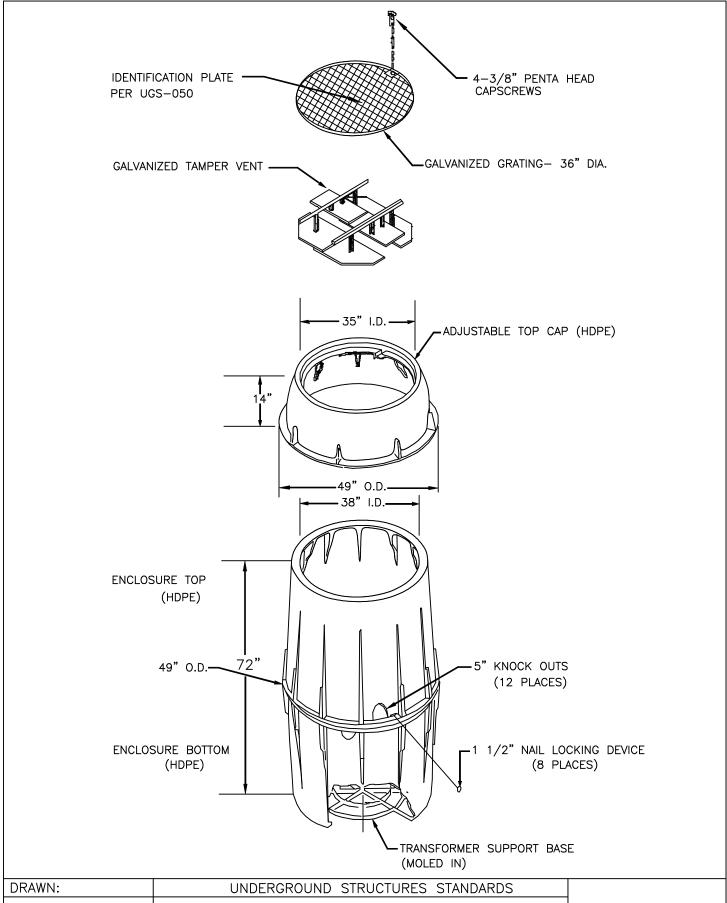

DRAWN.	UNDERGROUND STRUCTURES STANDARDS	
CHECKED:	PLASTIC	UGS-734.1
APPROVED:		000 701.1
DATE: 8/13/1998	(CARSON INDUSTRIES TYPE)	PAGE 2 OF 2